

# Rada Outlook

## Installer Information

---

- ✓ Digital thermostatic mixing valve sensor system
- ✓ For up to 6 outlets – showers or basins
- ✓ Programmable fixed warm water temperatures
- ✓ WaterMark licenced to AS 4032.1 (TMV Standard)
- ✓ Rada Outlook is a TMV – Do not install additional TMVs that supply water to or from Rada Outlook



[OUTLOOK MANUAL](#) 

[SENSOR MANUAL](#) 



[INSTALLATION  
VIDEO](#)

[QUICK INSTALL GUIDE](#) 

[PROGRAMMING](#) 

10m max pipework to outlets

# Rada Outlook

Layout

Rada Outlook is a TMV.

Do not install additional TMVs that supply water to or from Rada Outlook.

Electrician to connect power plug & provide 240V GPO with on/off switch



**1621.112 - IR Sensor**  
with 6m cable

**1621.085 - Piezo Sensor**  
with 3m cable

**1621.099 - Digital Thermostatic Mixing Valve Unit**  
Install in an easy to access dry location

**1621.202 - Programming Kit**  
Leave with facility manager



OR



Extend with LAPP Unitronic  
LIYY 3 x 0.25 cable  
Part No. 0028303

Available from  
Treotham, MEM, Rexel  
& L&H Groups

Extend with LAPP Unitronic  
LIYY 2 x 0.34 cable  
Part No. 0028402

Mixer valve with integrated  
solenoid valves (up to 6 outlets)

Control box



Install isolating valves  
on inlets & outlets




Showerheads & spouts sold separately

# Unused Outlets on Mixer Valve

To prevent any risk of water being released from an unused outlet, one of the following **MUST** be done for EACH unused outlet:

- a) Preferred method - Connect each unused outlet pipe into an adjacent in-service outlet pipe. This allows duty flushing to be done (see diagram).
- b) Cap off all unused outlets (caps not supplied).

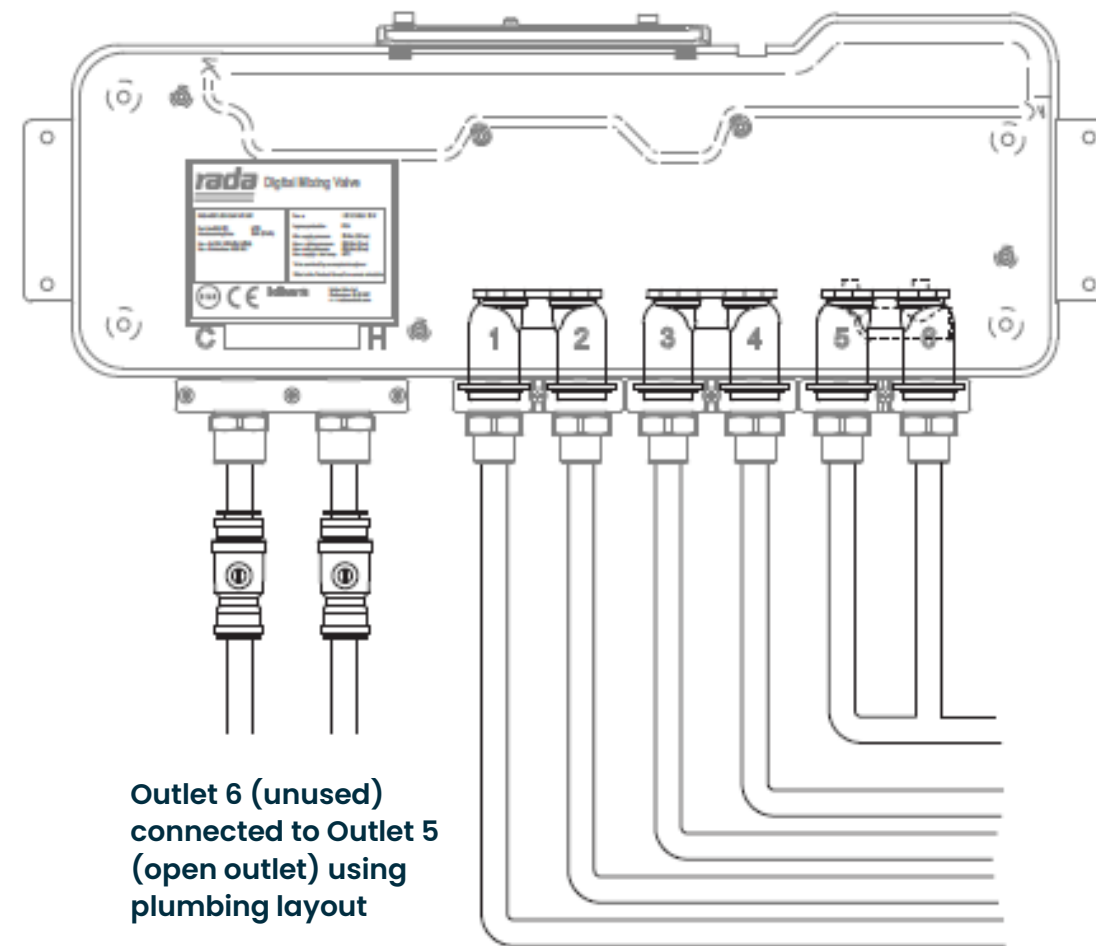


Outlet 6 (unused) connected to Outlet 5 (open outlet) using plumbing layout

Do not install additional TMVs in the pipework that supplies water to or from Rada Outlook

## Multiple Control Boxes?

When there are multiple Rada Outlook units:

- a) Connect each Control Box with Cat 5 cable

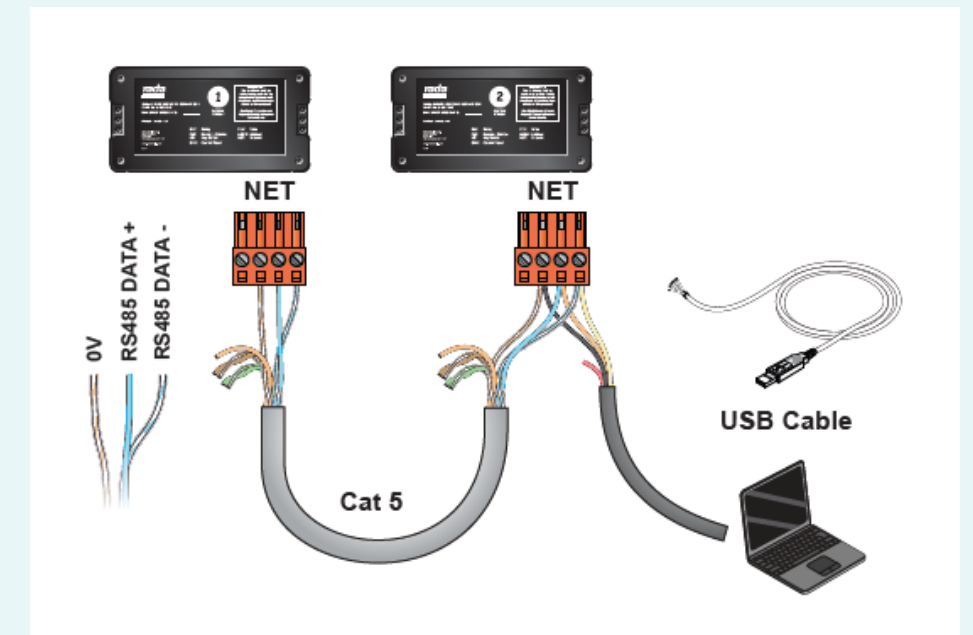

- b) Set the address as per the Outlook Manual (page 25-26) and Installation Video

